


**Boral Construction Materials
Materials Technical Services**

 Unit 4, 3-5 Gibbon Road
 Baulkham Hills NSW 2153 Australia
 PO Box 400, Winston Hills NSW 2153

T: +61 (02) 9624 9900

F: +61 (02) 9624 9999

www.boral.com.au

TEST REPORT

Req No: 64806
File No: 258/15
Laboratory Sample No: 171898
Job description: CURING COMPOUND EVALUATION

Test Method: AS 3799 - 1998

CLIENT: EVENRANGE PTY LTD

Distributor: Evenrange

Sample identification: Evencure AC

Sample Description: Acrylic based curing compound

Classification: Class D, Type 1

Source of sample: supplied by client

Date of sampling: October 2015

Date of test: 2.11.2015
Method of application: by spraying at standard application rate of 5m²/L

TEST RESULTS:

Standard property, Test (Method)	Specification	Result	
Water retention efficiency AS 3799.3.1.2 (Method AS 3799 Appendix B)	Min. 90%	95%	
Non - volatile content AS 3799.3.1.8 (Method AS 1580.301.1/ RTA T865)	N / A	48.4	NATA accreditation does not cover performance of these tests
Density AS 3799.3.1.9 (Method AS 1580.2002.1)	N / A	0.962	
Viscosity AS 3799.3.1.5 (Method AS 1580.214.5)	Min. 0.05 Pa's	0.12 Pa's	
Drying Time AS 3799.3.1.4 (Method AS 1160 Appendix C)	Max. 4 hrs	3hrs	
Stability of emulsion T 862 (RTA 3203)	Max 4%	23.8%	
Infrared absorption spectrum AS 3799.3.2 (Boral Method)	N / A	attached	
Residue 150µm AS 3799.3.1.6 (Method AS/NZS 2341.20)	Max. 0.2%	0.11%	

The sample submitted and identified by the client.

Kane Latham, File res, , File



Approved Signatory

 Date 13.11.2015 Serial No. _____


V.Mukhin

14 1375

Accredited for compliance with ISO/IEC 17025

NATA Accredited Laboratory

Number: 547

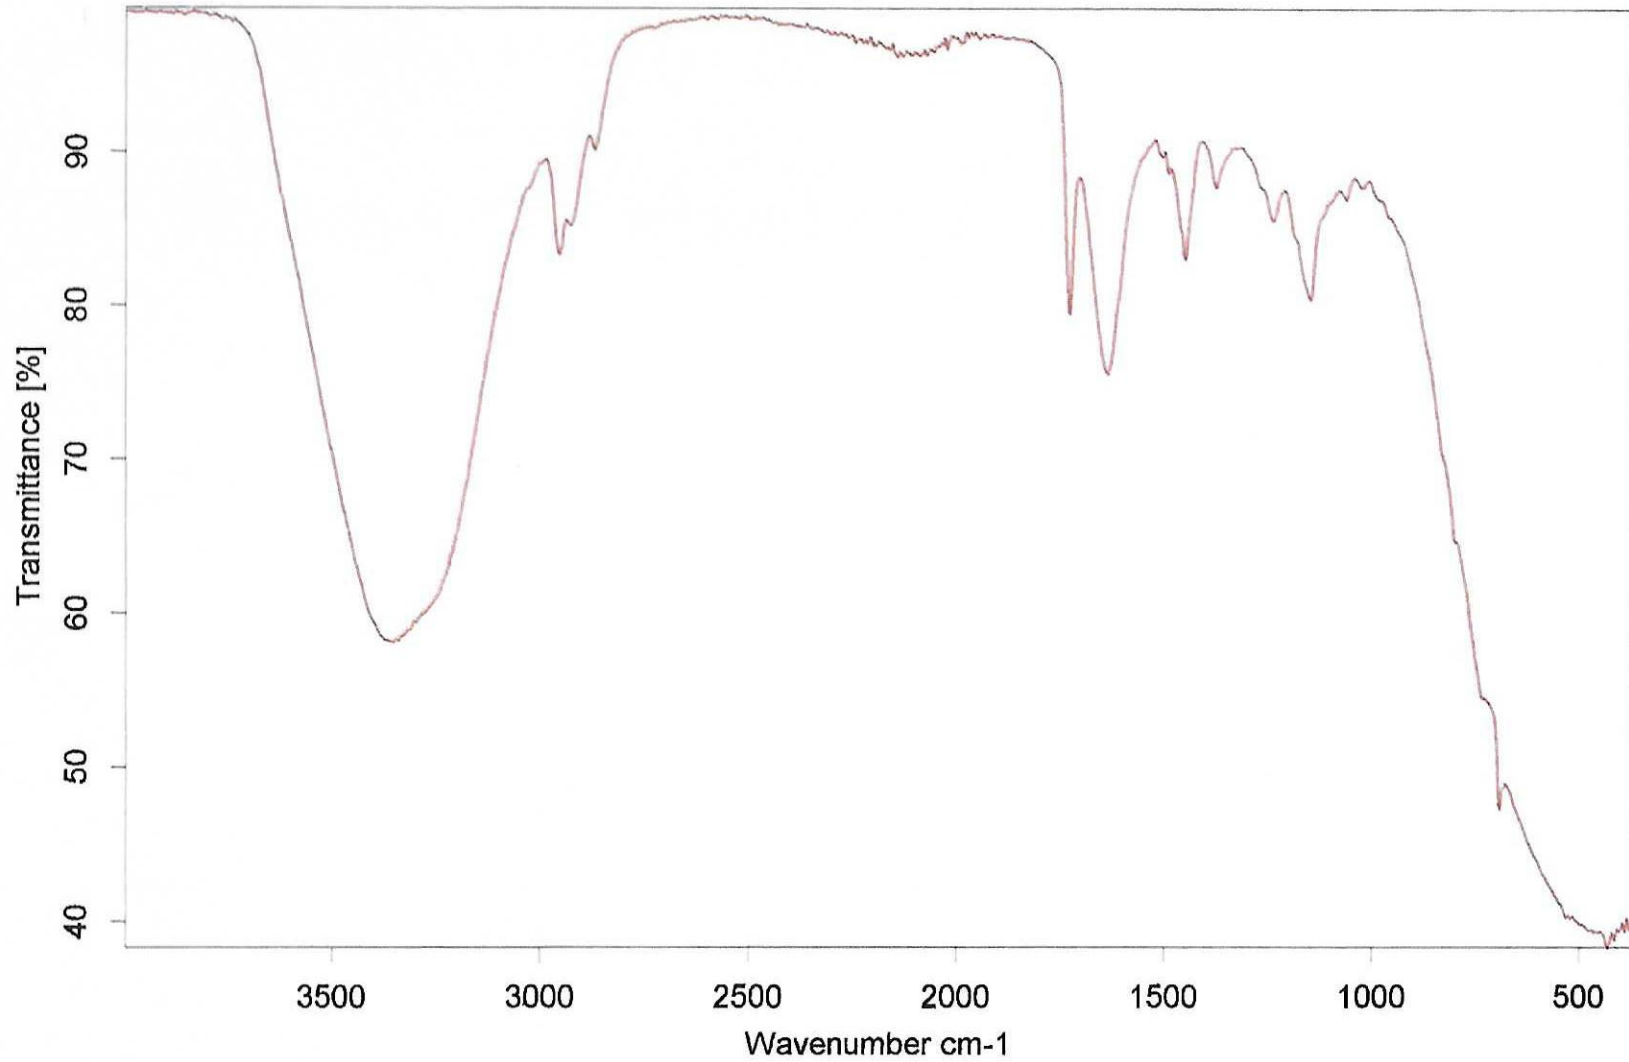

LSN 171898 Product name : Evencure AC Distributor : Evenrange

NR 12/11/15